



DEPARTMENT OF THE AIR FORCE  
28TH MEDICAL OPERATIONS SQUADRON (AFGSC)  
ELLSWORTH AIR FORCE BASE, SOUTH DAKOTA

12 Apr 2016

MEMORANDUM FOR 28 BW/PA

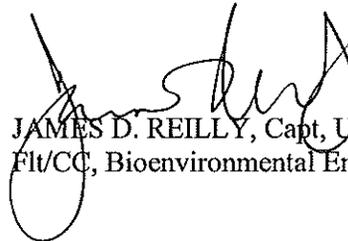
FROM: 28 MDOS/SGOJ

SUBJECT: April 2016 Compliance Water Monitoring Results

1. During the month of April 2016, the Bioenvironmental Engineering Flight (BEF) collected eight samples from state approved sites. Sampling is performed each month based on monitoring frequency requirements outlined in AFI 48-144, *Drinking Water Surveillance Program*, Para 4.1., and South Dakota Department of Environmental and Natural Resources (SD DENR) guidance. Below is a summary of samples collected in the month of April.

Site	Chlorine	pH	Bacteriological	Fecal
Bldg. 7712, Youth Center	0.2	7.6	Absent	Absent
Bldg. 4500, Bandit Lanes	0.8	7.7	Absent	Absent
Spigot #2, 477 Roosevelt Dr.	0.8	7.8	Absent	Absent
Bldg. 7430, ALS	0.8	7.8	Absent	Absent
Bldg. 8003, CDC	0.6	7.8	Absent	Absent
Spigot #1, 132 Maple Dr.	0.3	7.8	Absent	Absent
Bldg. 9025, CATM	0.4	7.8	Absent	Absent
Bldg. 7251, Flight Line Control Room	0.7	7.8	Absent	Absent

2. Drinking water standards set by the Environmental Protection Agency (EPA) and SD DENR, prescribe acceptable levels of chlorine and pH within a water system. Chlorine residual is maintained between 0.1-2.0 mg/L and pH at levels between 6.5 and 8.5. All samples are in compliance with EPA and state standards. Please contact the BEF at 385-3172 with any questions.

  
JAMES D. REILLY, Capt, USAF, BSC  
Flt/CC, Bioenvironmental Engineering